


CRUSHED STONE OR CRUSHED GRAVEL, CA-7 CLASS 1A TO PROVIDE ADEQUATE SUPPORT.

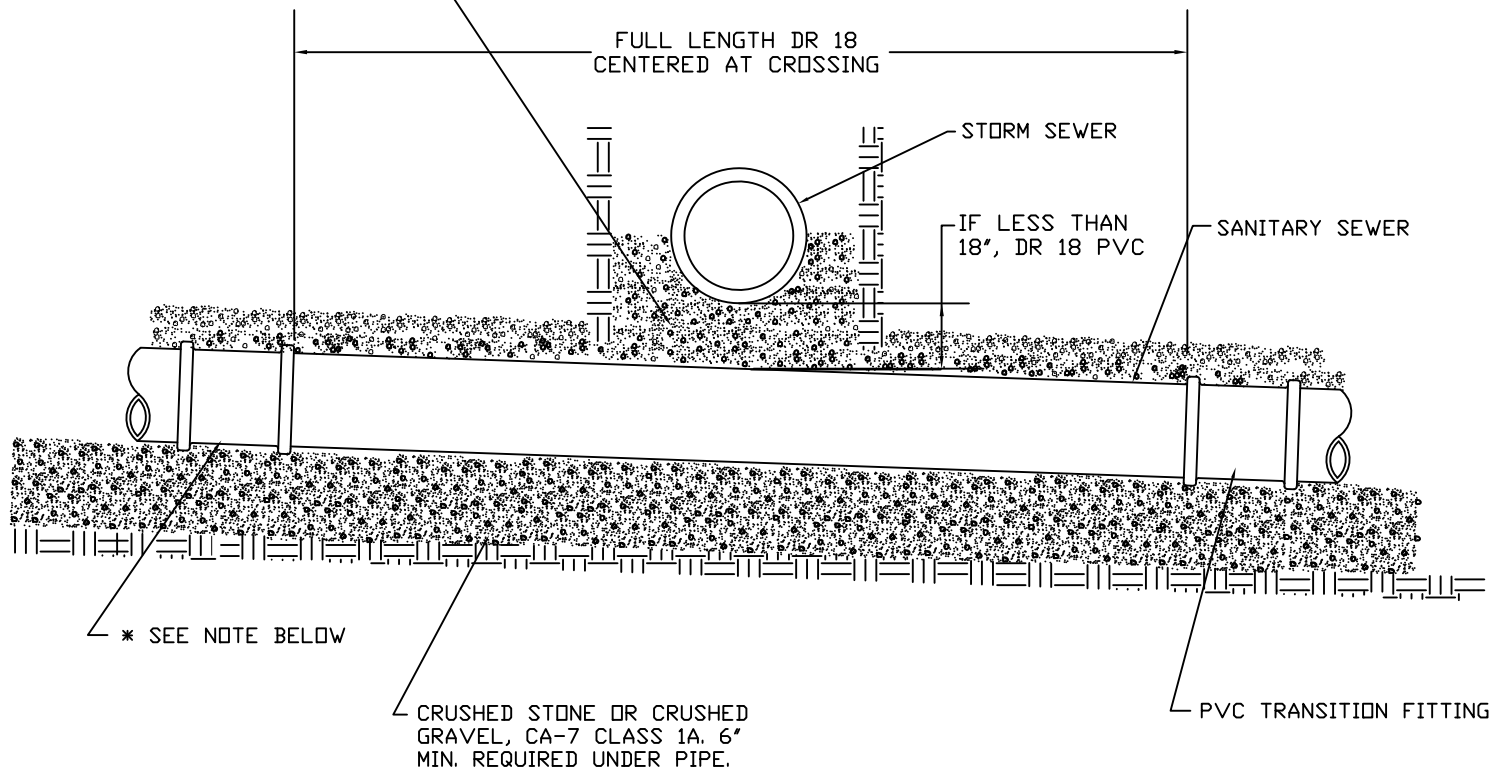

NOTE

* SHOW DR 18 TO 10' BEYOND EACH SIDE-WALL OF THE STORM SEWER. IF CONFLICT AREA IS WITHIN 30' OF A MANHOLE, CONSTRUCT DR 18 TO SAID MANHOLE.

IN LIEU OF ABOVE STANDARD METHOD, DR 18 MAY BE INSTALLED MANHOLE TO MANHOLE.

SANITARY SEWER CROSSING UNDER STORM SEWER

Fox Metro
Water Reclamation District

| | | | |
|----------|----------|----------|---|
| DESIGNED | FMWRD | REVISION | 2023 |
| DRAWN | KZ | G | Dimension Change 04/30/08 |
| APPROVED | KZ, MF | H | Full Length DR 18 Note Rev. 02/09/17 |
| DATE | 05-15-00 | I | Rev. "NOTE" 10' beyond side wall 7/22/2020 |
| SCALE | NTS | J | Added "if" to "Less than 18" note 1/26/2021 |
| SHEET | 1 | CAD DWG. | REVISION |
| OF | 1 | JOB NO. | J |