


REQUIRED WHEN A 10' MINIMUM SEPARATION IS NOT POSSIBLE FOR WATER AND SEWER SERVICES

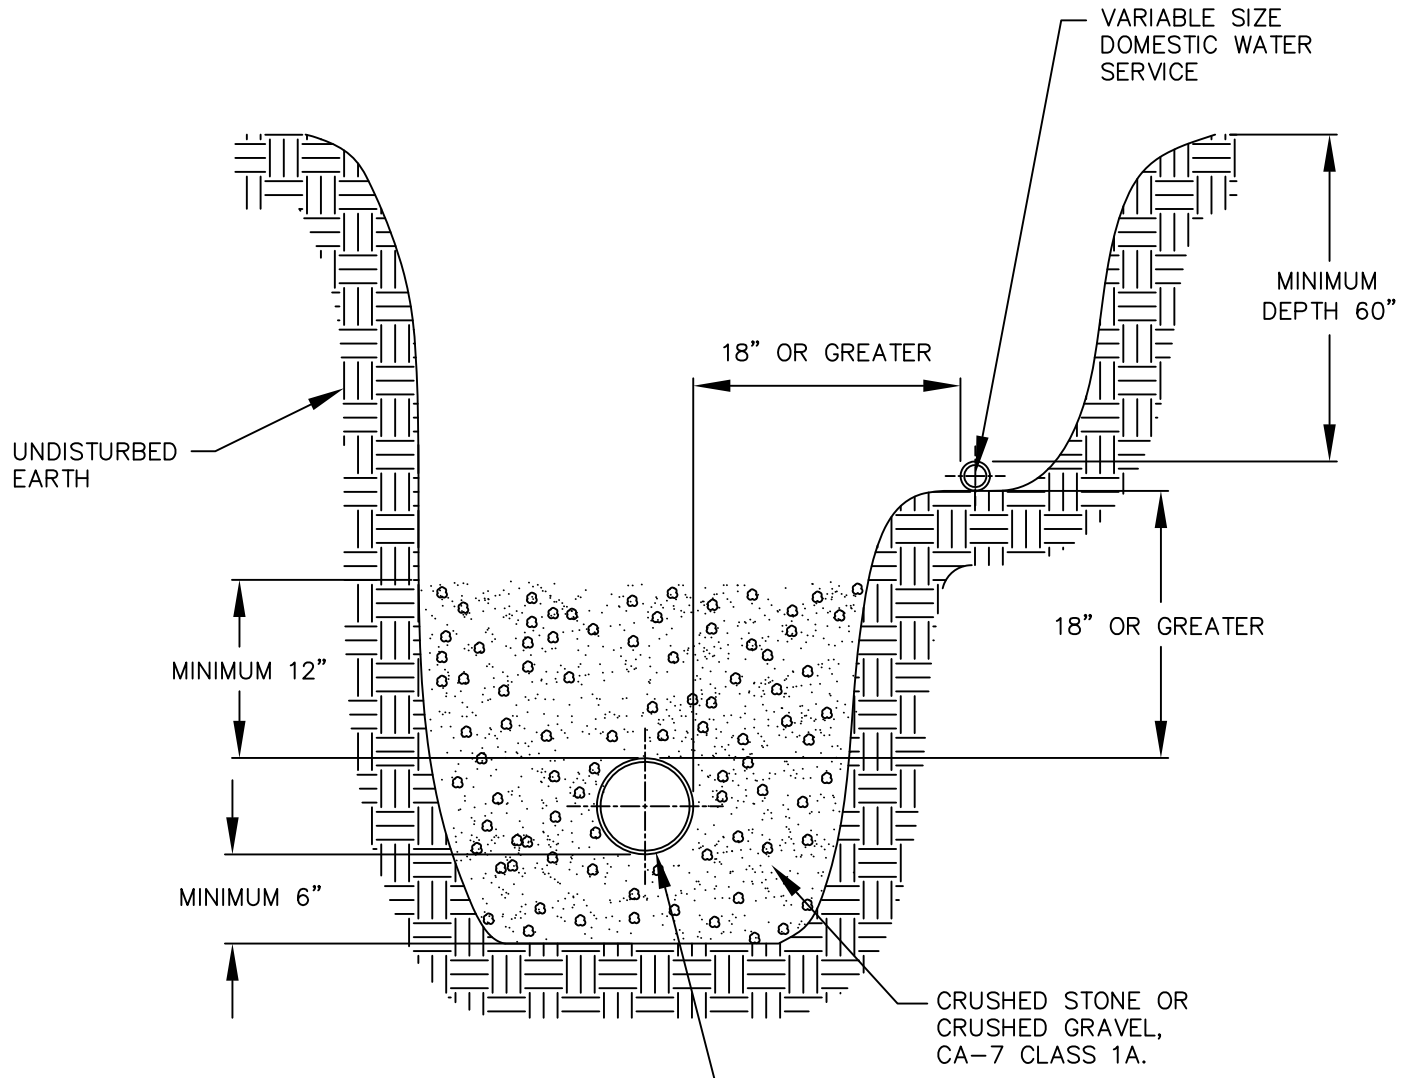

WHERE 10' HORIZONTAL SEPARATION AND MINIMUM DEPTH CANNOT BE ACHIEVED, RE-ROUTE WATER SERVICE IN ORDER TO ACHIEVE SEPARATION.

6" SANITARY SEWER SERVICE  
PVC ASTM D-2241 MINIMUM

NOTE

INSTALL PER "77 ILL. ADMIN. CODE PART 890  
ILLINOIS PLUMBING CODE" LATEST EDITION.

**SANITARY SEWER SERVICE & POTABLE  
WATER SERVICE SEPARATION**

**Fox Metro**  
Water Reclamation District

DESIGNED	FMWRD	REVISION	2023
DRAWN	KZ	A Revised	2004 01/05/04
APPROVED	KZ, MF	B Depth	Note 02/03/05
DATE	08-28-00	C Note	Revision 01/30/06
SCALE	NTS		
SHEET	1	CAD DWG.	REVISION C
OF	1	JOB NO.	