


EXISTING
STRUCTURE

EXISTING NON-PVC OR PVC
SERVICE TO BE REMOVED.

PIPES AT MANHOLES:
PER THE INSET BELOW-RIGHT,
FROM INSIDE OF MANHOLE,
INSTALL MECHANICAL PLUG AND
THEN FILL PIPE AND THROUGH
COMPLETELY WITH MORTAR.

PROPERTY LINE

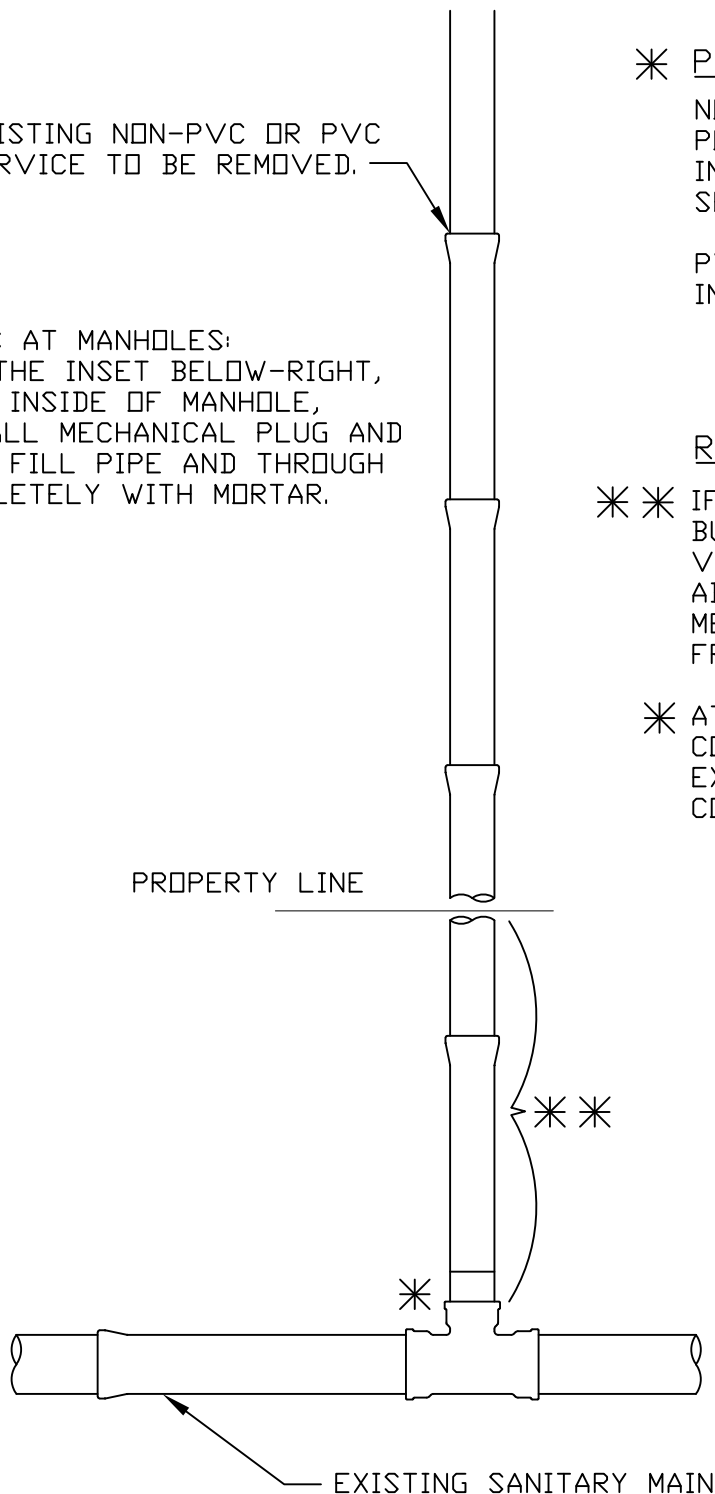

✱ PERMANENT ABANDONMENT


NON-PVC SERVICE: REMOVE PIPE TO A POINT 1' FROM THE PUBLIC MAIN, THEN INSTALL A MECHANICAL PLUG AND THEN SEAL WITH MORTAR (SEE INSET BELOW).

PVC SERVICE: REMOVE ALL PIPE, THEN INSTALL FACTORY PVC PLUG IN TEE.

RE-CONSTRUCTION

✱ ✱ IF THE RELATED PROPERTY IS DEEMED AS BUILDABLE IN THE FUTURE BY THE CITY OR VILLAGE, THE STUB MAY BE TEMPORARILY ABANDONED AT THE PROPERTY LINE. FOR FOX METRO W.R.D. TO APPROVE THIS, DOCUMENTATION FROM THE CITY OR VILLAGE IS REQUIRED.

✱ AT THE APPROPRIATE TIME OF RE-CONSTRUCTION, CONNECT NEW P.V.C. PIPE TO LENGTH OF EXISTING PIPE AT THE MAIN USING A NON-SHEAR COUPLING, OR STUB MAY BE C.I.P.P. LINED.

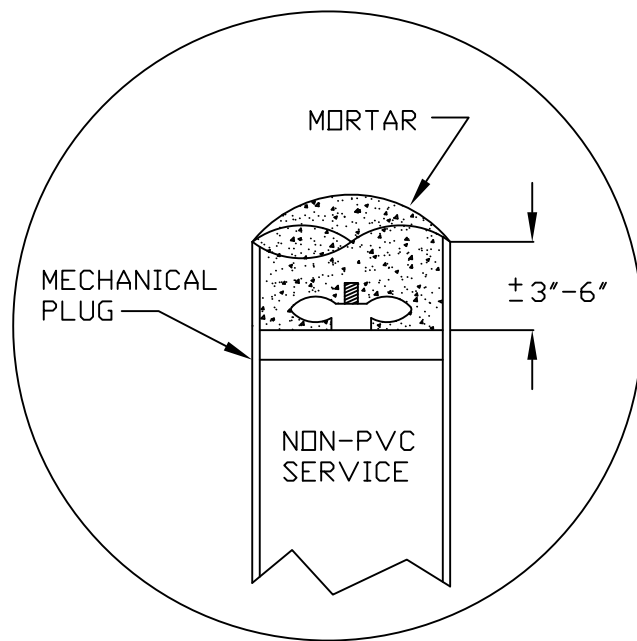

SANITARY SEWER SERVICE ABANDONMENT/RECONSTRUCTION

Fox Metro
Water Reclamation District

DESIGNED FMWRD	REVISION	2023
DRAWN KZ	C	Rev. notes to reflect abandon at main 12/14/16
APPROVED KZ, MF	D	Documentation note added 02/10/17
DATE 05-09-06	E	Permanent Abandonment Note Revision 06/08/2020
SCALE NTS	F	Permanent Abandonment Note Revision 6/29/2022
SHEET 1	CAD DWG.	
OF 1	JOB NO.	